





REZNOR®

IMPORTANT

1. Always include complete heater model and serial number so that any specification change can be considered for parts replacement. It can save time and expense.
2. Specifications are subject to change without notice.
3. We reserve the right to substitute functional replacements
4. Order by P/N; not Heater Option Designation.

Replacement Parts for V3® Series Model UDAP, UDAS, UDBP, and UDBS Unit Heaters

Index of Parts by Page No.	Model			
	UDAP	UDAS	UDBP	UDBS
Belt	--	--	10	10
Blower and Components	--	--	12	12
Bracket for Mounting Thermostat (Same as Option CM3)	19	19	19	19
Burner	14	14	14	14
Cabinet Parts	11	11	11-12	11-12
Capacitor, Fan or Blower Motor	5-6	5-6	8	8
Capacitor, Venter Motor	13	13	13	13
Ceiling Suspension Kit (same as Option CK22)	20	20	--	--
Concentric Adapter Box for Separated Combustion	--	15	--	15
Contactors	--	--	8	8
DDC Controller	7	7	7	7
Downturn Outlet Nozzles (same as Options CD 2, 3, 4, 5)	17	17	17	17
Drive	--	--	10	10
Duct Flange (same as Option CD9)	--	--	18	18
Electrical Components	4-7	4-7	4-9	4-9
Fan Blade	11	11	--	--
Fan Guard	11	11	--	--
Flame Sensor	4-6	4-6	4-6	4-6
Flue Wrapper	13	13	13	13
Fuse	6	6	6	6
Gas Conversion Kits	14	14	14	14
Guards - Belt Guard/Blower Inlet Guard (same as Option CD10 or CD12)	--	--	18	18
Hanger Kits (same as Options CK 8, 10)	20	20	20	20
Heat Exchanger	14	14	14	14
Ignition Control Board (Circuit Board)	4-6	4-6	4-6	4-6
Ignitor	4-6	4-6	4-6	4-6
Isolator for Fan Guard	11	11	11	11
Limit Control, High Temperature	4-6	4-6	4-6	4-6
Louvers, Horizontal	11	11	11	11
Louvers, Vertical (same as Option CD1)	17	17	17	17
Motor, Fan on UDAP/UDAS or Blower on UDBP/UDBS	4-6	4-6	8-9	8-9
Motor, Venter	13	13	13	13
Multiple Heater Control (same as Options CL 31, 32)	19	19	19	19
Orifice	14	14	14	14
Paint (spray touchup)	11	11	11	11
Rating Plate	2	2	2	2
Serial Number	2-3	2-3	2-3	2-3
Spring for Louvers	11	11	11	11
Switch, Disconnect	--	4	--	4
Switch, Door	--	4	--	4
Switch, Flame Rollout	4-6	4-6	--	--
Switch, Pressure (0-6000ft Elevation)	4-6	4-6	4-6	4-6
Switch, Pressure (over 6000ft Elevation)	16	16	16	16
Terminal Board	4-6	4-6	4-6	4-6
Thermostats and Accessories	19	19	19	19
Transformer (control)	4-6	4-6	4-6	4-6
Transformer (stepdown)	7	7	6, 7	6, 7
Valve (electric)	4-6	4-6	4-6	4-6
Valve (manual)	20	20	20	20
Vent Cap (same as Option CC1)	16	--	16	--
Vent/Combustion Air Kits (same as Options CC2, CC6, and CC14)	--	15	--	15
Venter Parts	13	13	13	13

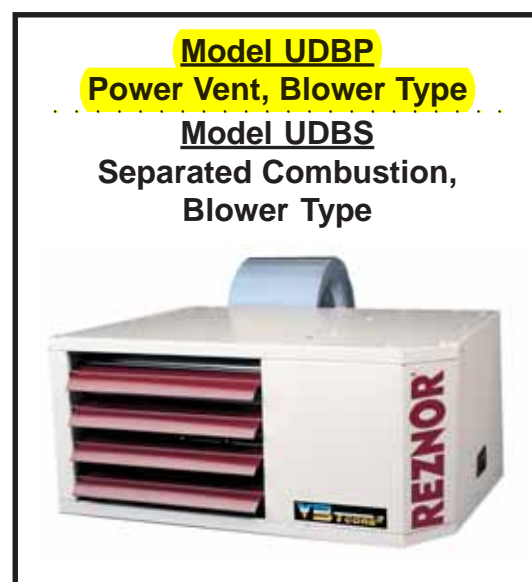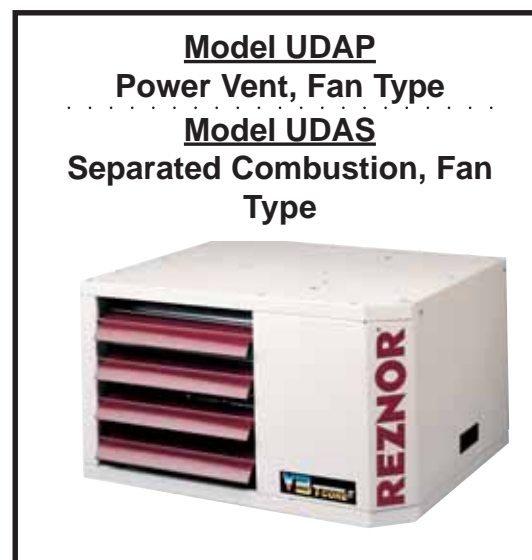

Warranty - Models UDAP, UDAS, UDBP, and UDBS

- One-year limited warranty on the heater.
- Nine-year extended limited warranty on the heat exchanger, burner, and flue collection box assembly.
- Four-year extended limited warranty on all electrical and mechanical operating components (with the exception of blower belts).

Contact your distributor for details.

Accessories/Options

CODE 140 - Vent Cap - Models UDAP and UDBP (Same as Option CC1)



Code	Description	30	45	60	75	100	125	150	175	200	225	250	300	350	400	
140A	Vent Cap for standard UDAP and UDBP	111848, 4"					111849, 5"					111850, 6"				
140B	Vent Cap for UDAP-CV (Model UDAP with Option AV6 for common venting)	111848, 4"			111849, 5"		--	--	--	--	--	--	--	--	--	--

CODE 141 - High Altitude Pressure Switch Kit - Above 6000 ft/1830M Elevation (Same as Option DJ20, DJ21) - Models UDAP, UDAS, UDBP, UDBS as listed

See pressure switch locations in illustrations on pages 4 and 5.



Option DJ20 for Model UDAP installed as a standard Power Vented Fan-Type Unit Heater	Model UDAP	30	45	60	75	100	125	150	175	200	225	250	300	350	400
	Pkg P/N	197117			197118			197117			201162			201163	
	High Altitude Switch P/N	197031			197032			197031			201160			201161	
	Negative Pressure OFF Setpoint "w.c.	0.35			0.45			0.35			1.05			1.30	
	Label color	Purple			Pink			Purple			Brown			White	
Option DJ21 applies only to Model UDAP-CV with Option AV6 for Common Venting	Model UDAP-CV	30	45	60	75	100									
	Pkg P/N	197119	197118	197120		197121									
	High Altitude Switch P/N	197029	197032	196362		196388									
	Negative Pressure OFF Setpoint "w.c.	0.60	0.45	0.55		0.50									
	Label color	Lt Blue	Pink	White		Orange									
Option DJ20 for Model UDAS Separated Combustion Fan-Type Unit Heater	Model UDAS	30	45	60	75	100	125	150	175	200	225	250	300	350	400
	Pkg P/N	197119				197121	197205	197117		201162			201163		
	High Altitude Switch P/N	197029				196388	197030	197031		201160			201161		
	Differential Pressure OFF Setpoint "w.c.	0.60				0.50	0.40	0.35		1.05			1.30		
	Label color	Lt. Blue				Orange	Green	Purple		Brown			White		
Option DJ20 for Model UDBP Power Vented Blower-Type High Static Unit Heater	Model UDBP	30	45	60	75	100	125	150	175	200	225	250	300	350	400
	Pkg P/N	197117			197118			197117			201162			201163	201162
	High Altitude Switch P/N	197031			197032			197031			201160			201161	201160
	Negative Pressure OFF Setpoint "w.c.	0.35			0.45			0.35			1.05			1.30	1.05
	Label color	Purple			Pink			Purple			Brown			White	Brown
Option DJ20 for Model UDBS Separated Combustion Blower-Type High Static Unit Heater	Model UDBS	30	45	60	75	100	125	150	175	200	225	250	300	350	400
	Pkg P/N	197117	197118	202103	197118	197117	197205	197117		201162			201163	201162	
	High Altitude Switch P/N	197031	197032	196362	197032	197031	197030	197031		201160			201161	201160	
	Differential Pressure OFF Setpoint "w.c.	0.35	0.45	0.55	0.45	0.35	0.40	0.35		1.05			1.30	1.05	
	Label color	Purple	Pink	White	Pink	Purple	Green	Purple		Brown			White	Brown	