


OPTIONS:
MATERIAL: 14ga. GALV STEEL
INSULATED PANELS (WHERE REQUIRED)
1" 1-1/2LB DUCT INSULATION (R VALUE 3.85)
GASKET PROVIDED WITH CURB
1 1/2" ADDED TO EXISTING CURB O.D.





DIMENSIONED AND TOLERENCED PER ANSI Y14.5M-1982

REVISIONS				
REV.	ECO#	DESCRIPTION	DATE	APPROVED
1		INITIAL DRAWING	5/7/2026	NMN

Attn: _____
Tag: **20T**
Approval: _____

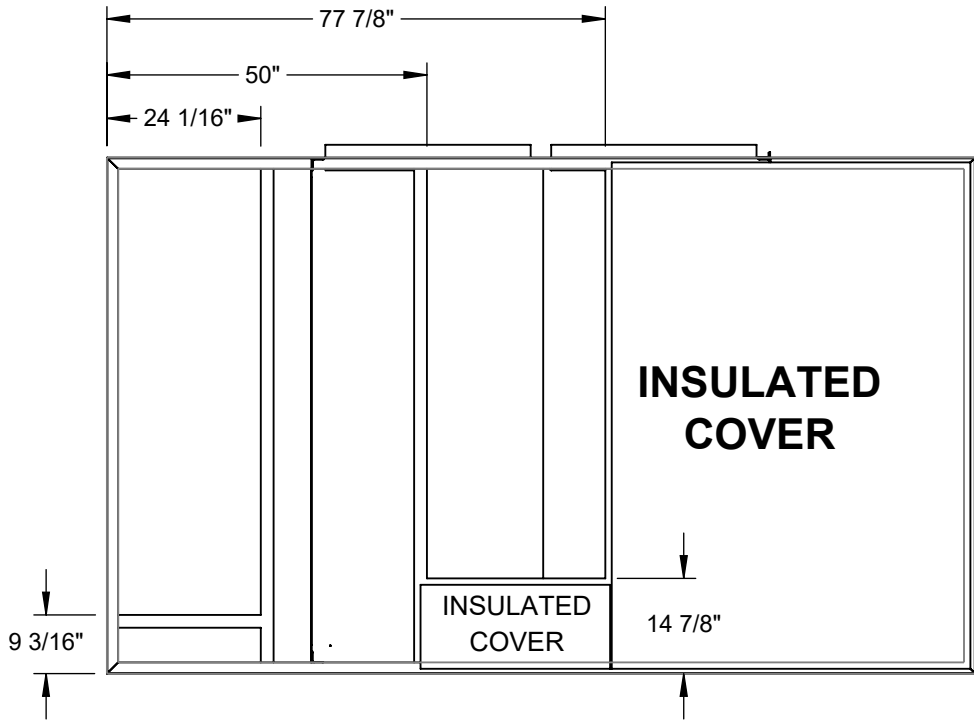

EXISTING CURB LAYOUT

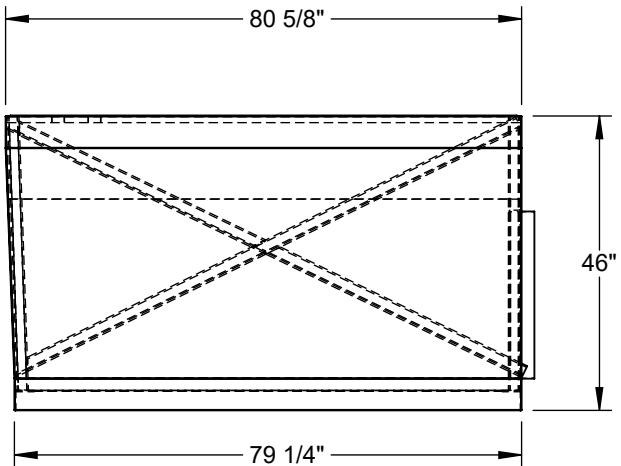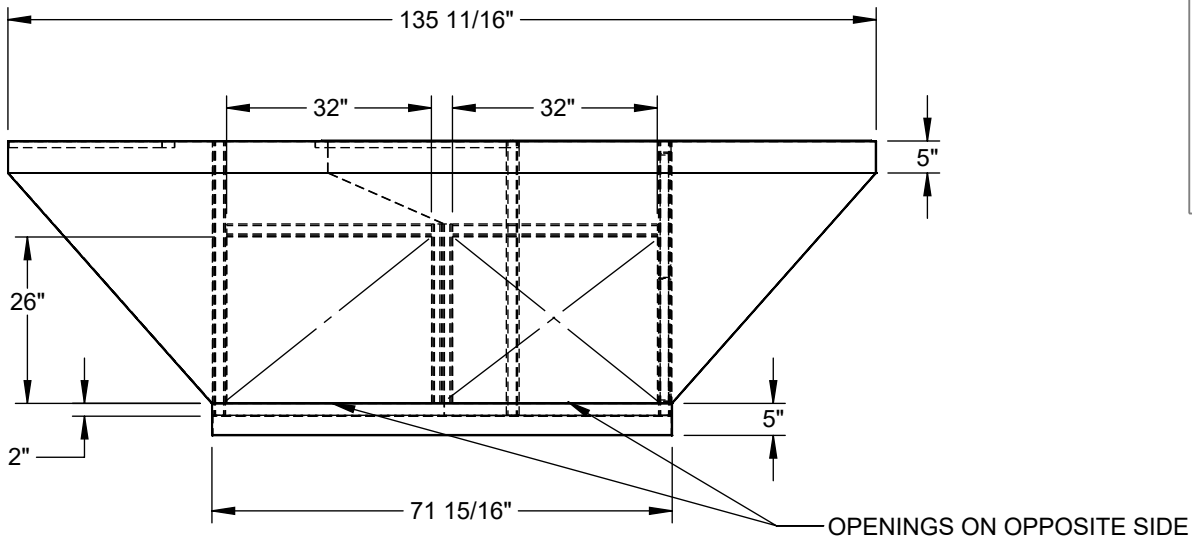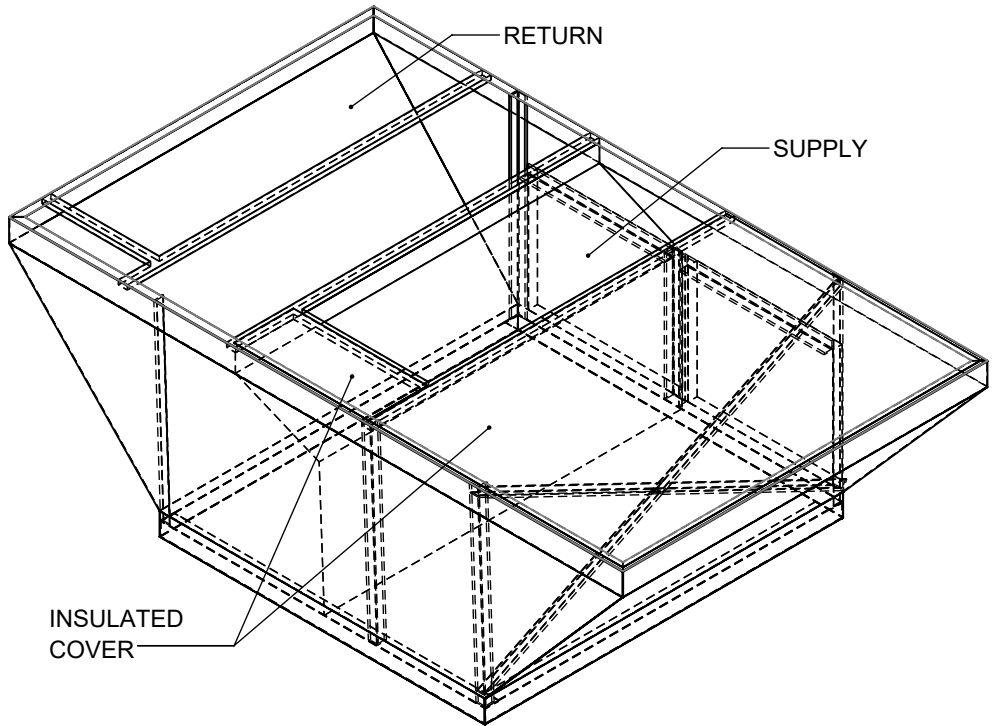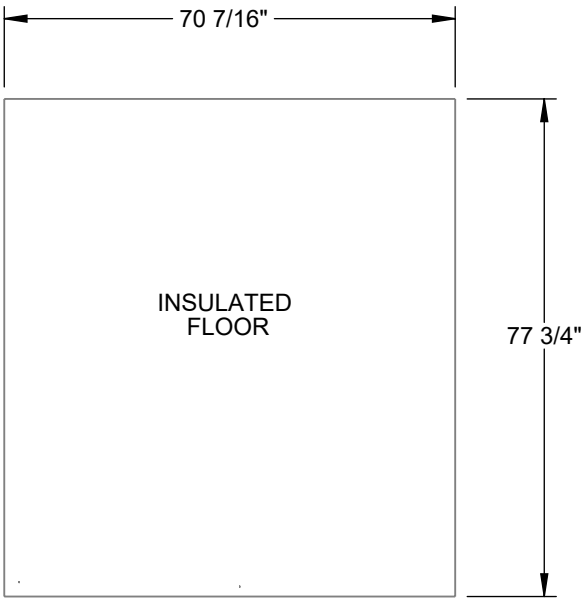

CURB SHOWN IS CDI STANDARD CONFIGURATION CDI RESERVES THE RIGHT TO CHANGE LAYOUT WITHOUT NOTIFICATION. IF CURB IS NEEDED IN A DIFFERENT CONFIGURATION CDI MUST BE NOTIFIED PRIOR TO PLACING AN ORDER.

OPERATIONAL HEIGHT OF CDI ADAPTER IS 3" LESS THAN OVERALL CURB HEIGHT SHOWN.

THIS DRAWING & THE INFORMATION CONTAINED THEREIN IS THE CONFIDENTIAL, PROPRIETARY INFORMATION OF CRYSTAL DISTRIBUTION INC., & MAY NOT BE USED OR REPRODUCED WITHOUT THE APPROVAL OF CRYSTAL DISTRIBUTION, INC. ALL RIGHTS RESERVED	APPROVALS		DATE		TITLE/FILE NAME: 3232183-CM1-1-4010-4158			
	DRAWN: nnelms		5/7/2026					
	CHECKED:							
	DIMENSIONS ARE AS FOLLOWS: 1.00 in [25.40 mm]							
*VERIFY EXISTING CURB OD *VERIFY SUPPLY AND RETURN OPENINGS *NOTE ANY CHANGES *CALL WITH ANY QUESTIONS *FAX BACK IF DRAWING IS OK AS IS		 Contact us @ www.cdicurbs.com or 1-888-234-7001			APPROXIMATE CURB WEIGHT (LBS.)		ECO #:	REV:
					768.75			1
					SCALE: 1:30		SHEET: 1 OF 5	