

Unit Report For 48TCEM09A2A5-0A0A0_Submittal

Project: 1.0 RTU Submittals for Website - Page 1
Prepared By:

11/20/2019
03:41PM

Unit Parameters

Unit Model:.....**48TCEM09A2A5-0A0A0**
Unit Size:.....**09 (8.5 Tons)**
Volts-Phase-Hertz:.....**208-3-60**
Heating Type:.....**Gas**
Duct Cfg:.....**Vertical Supply / Vertical Return**
Medium Heat
Round Tube Plate Fin Coils

Dimensions (ft. in.) & Weight (lb.) ***

Unit Length:.....**7' 4.125"**
Unit Width:.....**4' 11.5"**
Unit Height:.....**4' 1.375"**
*** Total Operating Weight:.....**835 lb**

*** Weights and Dimensions are approximate. Weight does not include unit packaging. Approximate dimensions are provided primarily for shipping purposes. For exact dimensions and weights, refer to appropriate product data catalog.

Lines and Filters

Gas Line Size:.....**3/4**
Condensate Drain Line Size:.....**3/4**
Return Air Filter Type:.....**Throwaway**
Return Air Filter Quantity:.....**4**
Return Air Filter Size:.....**16 x 20 x 2**

Unit Configuration

Medium Static Option (Belt Drive)
Al/Cu - Al/Cu
Base Electromechanical Controls
Standard Packaging

Warranty Information

1-Year parts(std.)
5-Year compressor parts(std.)
10-Year heat exchanger - Aluminized(std.)
15-Year heat exchanger - Stainless Steel(std.)

No optional warranties were selected.

NOTE: Please see Warranty Catalog 500-089 for explanation of policies and ordering methods.

Ordering Information



Part Number	Description	Quantity
48TCEM09A2A5-0A0A0	Rooftop Unit	1
	Base Unit	
	Electromechanical control, No intake or exhaust option.	
	No Electrical Option	

Certified Drawing for 48TCM09A2A5-0A0A0_Submittal

Project: 1.0 RTU Submittals for Website - Page 1
Prepared By:

11/20/2019
03:41PM

NOTES:

1. DIMENSIONS ARE IN INCHES, DIMENSIONS IN [] ARE IN MILLIMETERS.
2.  CENTER OF GRAVITY
3.  DIRECTION OF AIR FLOW

UNIT	OUTDOOR COIL TYPE	J	K	H
48TC-A08	RTPF	41 1/4 [1048]	33 [658]	15 7/8 [403]
48TC-A09	RTPF	49 3/8 [1253]	37 1/4 [946]	27 7/8 [709]
48TC-A12	RTPF	49 3/8 [1253]	37 1/4 [946]	15 7/8 [403]
48TC-D08	RTPF	41 1/4 [1048]	33 [658]	15 7/8 [403]
48TC-D09	RTPF	49 3/8 [1253]	37 1/4 [946]	15 7/8 [403]
48TC-D12	RTPF	49 3/8 [1253]	37 1/4 [946]	15 7/8 [403]
48TC-D08	MCHX	41 1/4 [1048]	33 [658]	23 [584.2]
48TC-D12	MCHX	49 3/8 [1253]	37 1/4 [946]	11 [279.4]

RTPF - ROUND TUBE, PLATE FIN (COPPER/ALUM)
MCHX - NOVAION (ALUM/ALUM)



UNITED
TECHNOLOGIES
CARRIER

P.O. BOX 4808
SYRACUSE, NY
13221

THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
A	1 3/8" [35] DIA FIELD POWER SUPPLY HOLE
B	2 1/2" [64] DIA POWER SUPPLY KNOCKOUT
C	1 3/4" [51] DIA GAUGE ACCESS PLUG
D	7/8" [22] DIA FIELD CONTROL WIRING HOLE
E	3/4"-14 NPT CONDENSATE DRAIN
F	1/2"-14 NPT GAS CONNECTION
G	3/4"-14 NPT GAS CONNECTION
G	2" [51] DIA POWER SUPPLY KNOCK-OUT

THRU-THE-BASE CHART (FIELD INST)






THESE HOLES REQUIRED FOR USE WITH ACCY KITS:
CRBTMPR002A01: GAS THRU CURB
CRBTMPR004A01: GAS THRU BASEPAN

	THREADED CONDUIT SIZE	WIRE USE	REQ'D HOLE SIZES (MAX.)
W	1/2"	ACC.	7/8" [22.2]
X	1/2"	24V	7/8" [22.2]
Y	1 1/4" (002,004)	POWER	1 3/4" [44.4]
Z *	(004) 3/4" FPT	GAS	1 3/4" [44.4]
*	(002) PROVIDES 3/4" FPT THRU CURB FLANGE & FITTING. HOLE SIZE: 2" [50.8]		

THRU-THE-BASE CHART (FIOP)

FOR "THRU-THE-BASEPAN" FACTORY OPTION, FITTINGS FOR ONLY X, Y, & Z ARE PROVIDED. **

** FOR BELOW LISTED MODELS, A FIELD SUPPLIED 1/2" ADAPTER IS REQUIRED BETWEEN BASE PAN FITTING AND GAS VALVE: 48HCD, S408

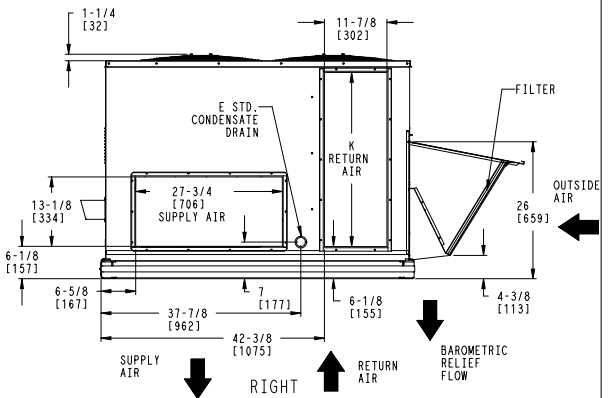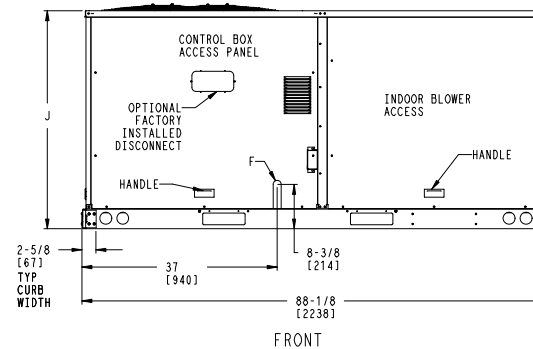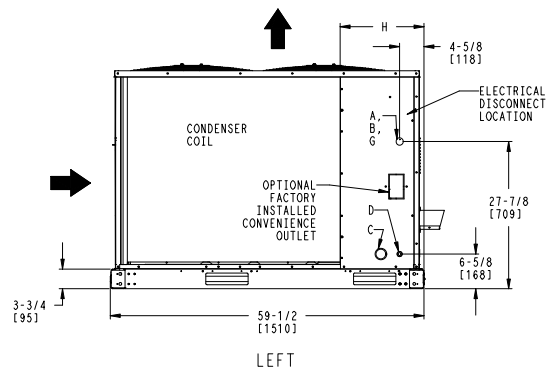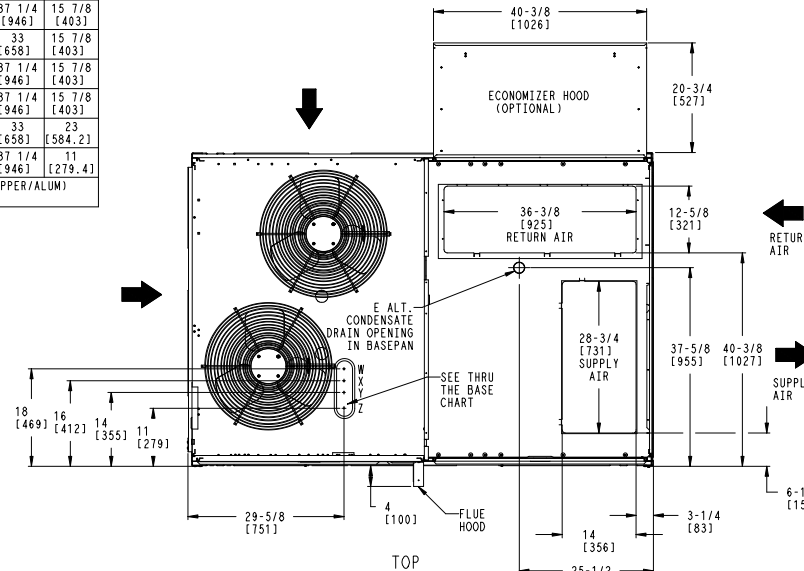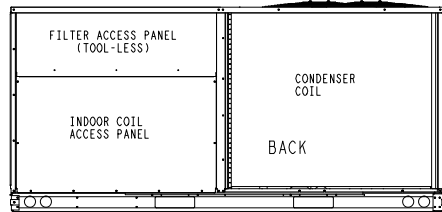

SHEET 1 OF 2	DATE 03-08-10	SUPERCEDES 11-24-08	48TC 08-12 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	48TM500985	REV F
-----------------	------------------	------------------------	--	------------	----------

Certified Drawing for 48TCM09A2A5-0A0A0_Submittal

Project: 1.0 RTU Submittals for Website - Page 1
Prepared By:

11/20/2019
03:41PM

UNIT	OUTDOOR COIL TYPE	STD. UNIT WEIGHT ***		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		C.G.		
		LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	X	Y	Z
48TC-A08	RTPF	780	354	178	81	158	72	209	95	236	107	41 1/2 [1054]	33 7/8 [860]	20 1/2 [521]
48TC-A09	RTPF	920	418	212	96	183	83	243	110	282	128	40 7/8 [1038]	34 [864]	23 1/8 [587]
48TC-A12	RTPF	930	422	216	98	196	89	247	112	272	123.5	42 [1067]	33 1/8 [841]	24 1/4 [616]
48TC-D08	RTPF	835	379	164	74.5	170	77.2	255	115.8	246	111.7	44 7/8 [1140]	35 5/8 [905]	19 3/8 [492]
48TC-D09	RTPF	930	422	228	103.5	187	85	232	105.3	283	128.5	39 3/4 [1010]	32 7/8 [835]	18 5/8 [473]
48TC-D12	RTPF	940	427	231	104.9	189	85.8	234	106.2	286	129.8	39 3/4 [1010]	33 [838]	18 1/2 [470]
48TC-D08	MCHX	805	365.5	160	72.6	153	69.5	240	109	260	118	43 [1092]	36 3/8 [924]	20 3/8 [517.7]
48TC-D12	MCHX	895	406.3	185	84	176	79.9	260	118	274	124.4	42 7/8 [1089]	35 1/2 [902]	22 7/8 [581]

RTPF - ROUND TUBE, PLATE FIN (COPPER/ALUM)
MCHX - NOVATION (ALUM/ALUM)




UNITED
TECHNOLOGIES SYRACUSE, NY
CARRIER

P.O. BOX 4808
13221

THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION
AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE
CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER
CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS
DOES NOT CONSTITUTE PART PERFORMANCE OR
ACCEPTANCE OF CONTRACT.

*** STANDARD UNIT WEIGHT IS WITH LOW GAS HEAT AND WITHOUT PACKAGING.
FOR OTHER OPTIONS AND ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.

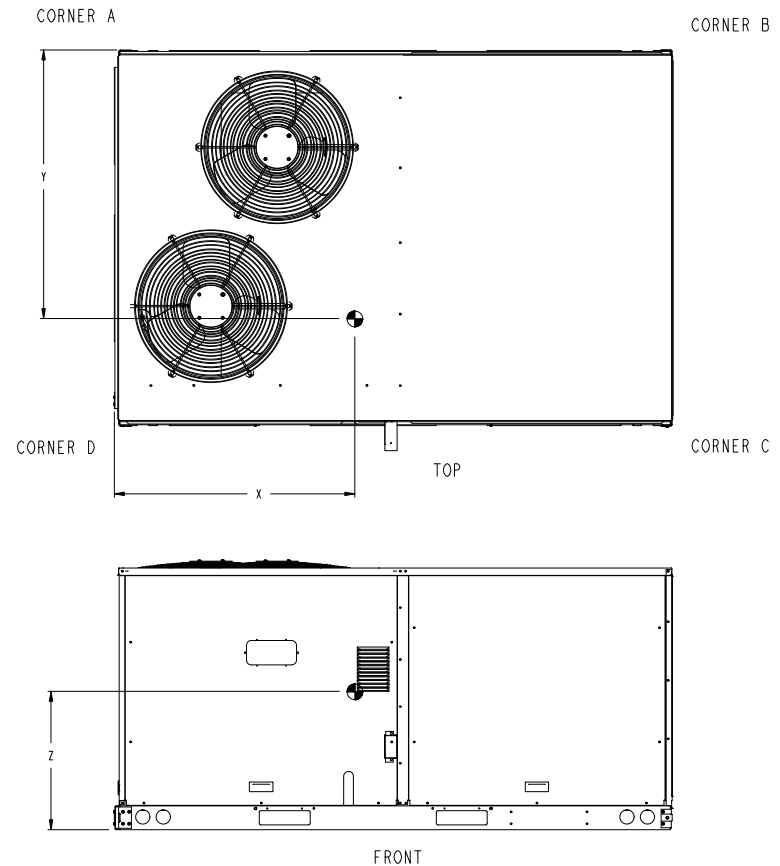


SHEET 2 OF 2	DATE 03-08-10	SUPERCEDES 11-24-08	48TC 08-12 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	48TM500985	REV F
-----------------	------------------	------------------------	--	------------	----------

Certified Drawing for 48TCEM09A2A5-0A0A0_Submittal

Project: 1.0 RTU Submittals for Website - Page 1
Prepared By:

11/20/2019
03:41PM

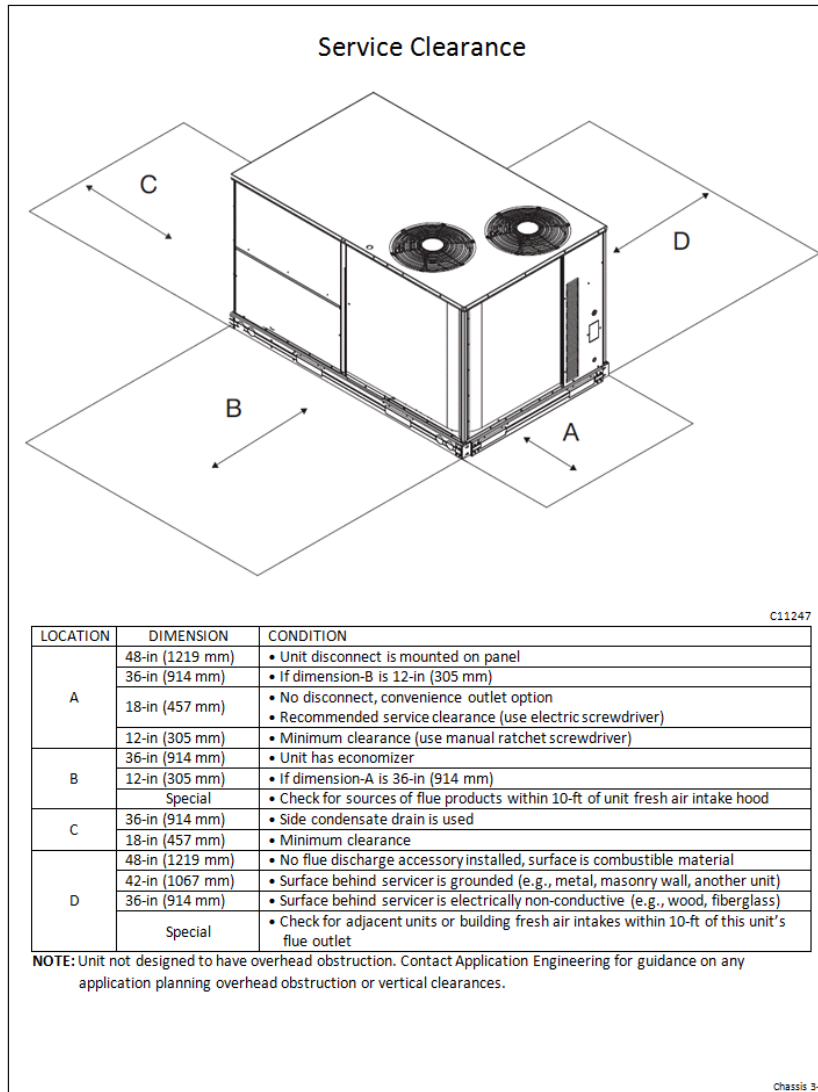

Performance Summary For 48TCEM09A2A5-0A0A0_Submittal

Project: 1.0 RTU Submittals for Website - Page 1
Prepared By:

11/20/2019
03:41PM

Part Number:48TCEM09A2A5-0A0A0

ARI EER:.....11.00
IEER:.....12.7

Base Unit Dimensions

Unit Length:.....88.1 in
Unit Width:.....59.5 in
Unit Height:.....49.4 in

Operating Weight

Base Unit Weight:.....805 lb
Medium Heat:.....15 lb
Medium Static Option (Belt Drive):.....15 lb

Total Operating Weight:.....835 lb

Unit

Unit Voltage-Phase-Hertz:.....208-3-60
Air Discharge:.....Vertical
Fan Drive Type:.....Belt
Actual Airflow:.....3000 CFM
Site Altitude:.....0 ft

Cooling Performance

Condenser Entering Air DB:.....95.0 F
Evaporator Entering Air DB:.....80.0 F
Evaporator Entering Air WB:.....67.0 F
Entering Air Enthalpy:.....31.44 BTU/lb
Evaporator Leaving Air DB:.....58.1 F
Evaporator Leaving Air WB:.....56.4 F
Evaporator Leaving Air Enthalpy:.....24.00 BTU/lb
Gross Cooling Capacity:.....100.35 MBH
Gross Sensible Capacity:.....70.87 MBH
Compressor Power Input:.....7.35 kW
Coil Bypass Factor:.....0.099

Heating Performance

Heating Airflow:.....3000 CFM
Entering Air Temp:.....70.0 F
Leaving Air Temp:.....115.7 F
Gas Heating Input Capacity:.....120.0 / 180.0 MBH
Gas Heating Output Capacity:.....98.0 / 148.0 MBH
Temperature Rise:.....45.7 F
Thermal Efficiency (%):.....82.0

Supply Fan

External Static Pressure:.....0.50 in wg
Fan RPM:.....689
Fan Power:.....1.01 BHP
NOTE:.....The Selected Indoor Fan Motor requires a Field-Supplied Drive (RPM Range: 690 - 936).

Electrical Data

Voltage Range:.....187 - 253
Compressor #1 RLA:.....28.8
Compressor #1 LRA:.....223
Indoor Fan Motor Type:.....MED
Indoor Fan Motor FLA:.....6.9
Combustion Fan Motor FLA (ea):.....0.48
Power Supply MCA:.....46
Power Supply MOCP (Fuse or HACR):.....60

Performance Summary For 48TCEM09A2A5-0A0A0_Submittal

Project: 1.0 RTU Submittals for Website - Page 1
Prepared By:

11/20/2019
03:41PM

Disconnect Size FLA:.....45
Disconnect Size LRA:.....288
Electrical Convenience Outlet:.....None
Outdoor Fan [Qty / FLA (ea)]:.....2 / 1.5


Control Panel SCCR: 5kA RMS at Rated Symmetrical Voltage

Acoustics

Sound Power Levels, db re 10E-12 Watts

	Discharge	Inlet	Outdoor
63 Hz	96.1	93.4	91.2
125 Hz	90.3	83.2	86.4
250 Hz	74.3	66.3	81.9
500 Hz	68.3	63.2	81.0
1000 Hz	63.0	60.6	78.3
2000 Hz	60.9	55.7	73.9
4000 Hz	63.9	54.7	71.4
8000 Hz	63.6	54.2	67.3
A-Weighted	77.1	71.5	83.0

Advanced Acoustics

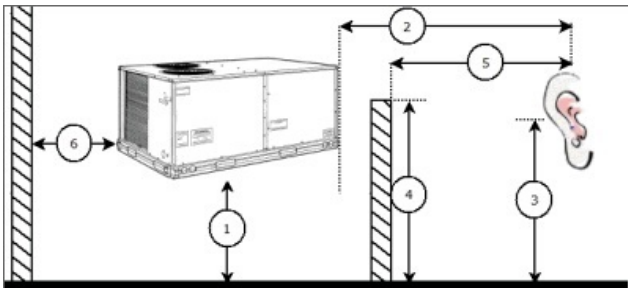

Advanced Acoustics Parameters

- Unit height above ground:.....30.0 ft
- Horizontal distance from unit to receiver:.....50.0 ft
- Receiver height above ground:.....5.7 ft
- Height of obstruction:.....0.0 ft
- Horizontal distance from obstruction to receiver:.....0.0 ft
- Horizontal distance from unit to obstruction:.....0.0 ft

Detailed Acoustics Information

Octave Band Center Freq. Hz	63	125	250	500	1k	2k	4k	8k	Overall
A	91.2	86.4	81.9	81.0	78.3	73.9	71.4	67.3	93.3 Lw
B	65.0	70.3	73.3	77.8	78.3	75.1	72.4	66.2	83.4 LwA
C	58.8	54.0	49.5	48.6	45.9	41.5	39.0	34.9	60.9 Lp
D	32.6	37.9	40.9	45.4	45.9	42.7	40.0	33.8	51.0 LpA

Legend

A Sound Power Levels at Unit's Acoustic Center, Lw
B A-Weighted Sound Power Levels at Unit's Acoustic Center, LwA
C Sound Pressure Levels at Specific Distance from Unit, Lp

Performance Summary For 48TCEM09A2A5-0A0A0_Submittal

Project: 1.0 RTU Submittals for Website - Page 1
Prepared By:

11/20/2019
03:41PM

D A-Weighted Sound Pressure Levels at Specific Distance from Unit, LpA

Calculation methods used in this program are patterned after the ASHRAE Guide; other ASHRAE Publications and the AHRI Acoustical Standards. While a very significant effort has been made to insure the technical accuracy of this program, it is assumed that the user is knowledgeable in the art of system sound estimation and is aware of the tolerances involved in real world acoustical estimation. This program makes certain assumptions as to the dominant sound sources and sound paths which may not always be appropriate to the real system being estimated. Because of this, no assurances can be offered that this software will always generate an accurate sound prediction from user supplied input data. If in doubt about the estimation of expected sound levels in a space, an Acoustical Engineer or a person with sound prediction expertise should be consulted.

